

Olympian OD175 Diesel Generator Set

Engine Model	Cat® C7.1 In-line 6, 4-cycle Diesel
Bore x Stroke	105 mm x 135 mm (4.1 in x 5.3 in)
Displacement	7.01 L (428 in³)
Compression Ratio	16.7:1
Aspiration	Turbocharged Air-to-Air-Aftercooled
Fuel Injection System	Electronic, Common Rail
Governor	Electronic

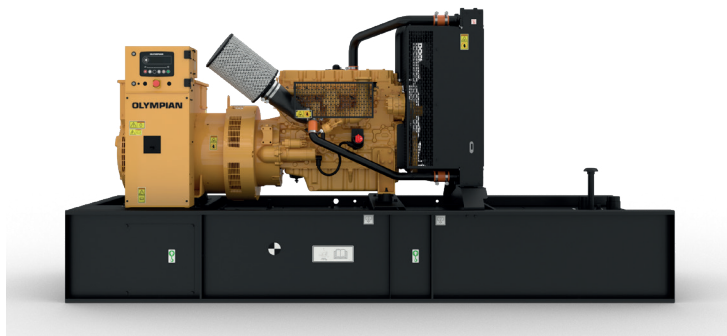


Image shown may not reflect actual configuration

Model	Standby	Emission Strategy
OD175	175 kW	EPA TIER III


Package Performance

Performance	Standby
Frequency, Hz	60
Genset power rating, kVA	219
Genset power rating with fan, 3p@ 0.8 power factor, kW	175
Performance number	P4378A
Fuel Consumption	
100% load with fan, L/hr (gal/hr)	51.2 (13.5)
75% load with fan, L/hr (gal/hr)	41.9 (11.1)
50% load with fan, L/hr (gal/hr)	28.6 (7.6)
Cooling System ¹	
Radiator air flow restriction (system), kPa (in. water)	0.12 (0.48)
Engine coolant capacity, L (gal)	9.5 (2.5)
Radiator coolant capacity, L (gal)	11.5 (3.0)
Total coolant capacity, L (gal)	21.0 (5.5)
Inlet Air	
Combustion air inlet flow rate, m³/min (CFM)	15.4 (543.8)
Max. allowable combustion air inlet temp, °C (°F)	51 (124)
Exhaust System	
Exhaust stack gas temperature, °C (°F)	509 (948)
Exhaust gas flow rate, m³/min (CFM)	34.8 (1229)
Exhaust system backpressure (maximum allowable), kPa (in. water)	15.0 (60.2)
Heat Rejection	
Heat rejection to exhaust (total), kW (BTU/min)	159.0 (9042)
Heat rejection to aftercooler, kW (BTU/min)	37.0 (2104)
Heat rejection to atmosphere from engine, kW (BTU/min)	32.0 (1820)
Emissions (Nominal) ²	
NOx + HC, g/kW-hr	4.0
CO, g/kW-hr	1.0
PM, g/kW-hr	0.2

Alternator³

Voltages, V	480	208	600
Motor starting capability @ 30% Voltage Dip, skVA	361	333	738
Current, Amps	263	607	211
Frame size	M2294L4	M2736L4	M2294L4
Excitation	SE	SE	AREP
Temperature rise, °C	105	105	130

Weights & Dimensions

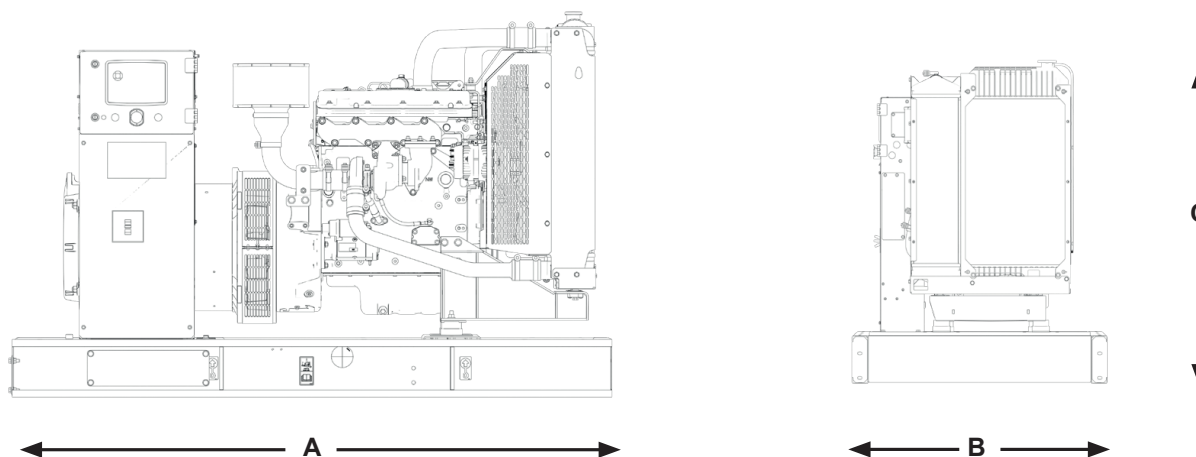

Length "A" mm (in)	Width "B" mm (in)	Height "C" mm (in)	Dry Weight kg (lb)
2634 (103.7)	1300 (51.2)	1492 (58.7)	1697 (3741)

Note: General configuration not to be used for installation. See general dimension drawings for detail.

Applicable Codes and Standards

CSA C22.2 No 100-04, UL142, UL489, UL869, cUL/UL2200, NFPA 37, NFPA 70, NFPA 99, NFPA 110, IBC, IEC60034-1, ISO 3046, ISO 8528, NEMA MG 1-33.

Codes may not be available in all model configurations. Please consult your local Olympian representative for availability.

STANDBY: Output available with varying load for the duration of the interruption of the normal source power. Average power output is 70% of the standby power rating. Typical operation is 200 hours per year, with maximum expected usage of 500 hours per year.

RATINGS: Ratings are based on SAE J1349 standard conditions. These ratings also apply at ISO3046 standard conditions.

Definitions and Conditions

- ¹ For ambient and altitude capabilities consult your Olympian representative.
Air flow restriction (system) is added to existing restriction from factory.
- ² Emissions data measurement procedures are consistent with those described in EPA CFR 40 Part 89, Subpart D & E and ISO8178-1 for measuring HC, CO, PM, NOx. Data shown is based on steady state operating conditions of 77° F, 28.42 in HG and number 2 diesel fuel with 35° API and LHV of 18,390 BTU/lb. The nominal emissions data shown is subject to instrumentation, measurement, facility and engine to engine variations. Emissions data is based on 100% load and thus cannot be used to compare to EPA regulations which use values based on a weighted cycle.
- ³ UL 2200 Listed packages may have oversized generators with a different temperature rise and motor starting characteristics. Generator temperature rise is based on a 40° C ambient per NEMA MG1-32.