

Olympian OD40 Diesel Generator Set

Engine Model	Cat® C4.4 In-line 4, 4-cycle Diesel
Bore x Stroke	105 mm x 127 mm (4.1 in x 5.0 in)
Displacement	4.4 L (269 in³)
Compression Ratio	18.2:1
Aspiration	Turbocharged
Fuel Injection System	Common Rail

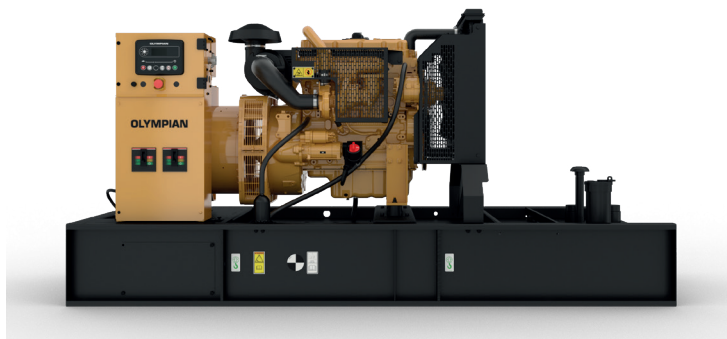


Image shown may not reflect actual configuration

Model	Standby	Emission Strategy
OD40	40 kW	SCAQMD Compliant (Tier 3 Nonroad Equivalent Emission Standard)


Package Performance

Performance	Standby	
	3-Phase	1-Phase
Frequency, Hz	60	
Genset power rating, kVA	50	40
Genset power rating with fan, 3p@ 0.8 & 1p@1.0 power factor, kW	40	
Performance number	P3454C-00	
Fuel Consumption		
100% load with fan, L/hr (gal/hr)	13.0 (3.4)	
75% load with fan, L/hr (gal/hr)	10.0 (2.6)	
50% load with fan, L/hr (gal/hr)	7.4 (2.0)	
Cooling System¹		
Radiator air flow restriction (system), kPa (in. water)	0.12 (0.48)	
Engine coolant capacity, L (gal)	7.0 (1.8)	
Radiator coolant capacity, L (gal)	9.5 (2.5)	
Total coolant capacity, L (gal)	16.5 (4.3)	
Inlet Air		
Combustion air inlet flow rate, m³/min (CFM)	5.3 (187.2)	
Max. allowable combustion air inlet temp, °C (°F)	45 (113)	
Exhaust System		
Exhaust stack gas temperature, °C (°F)	571 (1060)	
Exhaust gas flow rate, m³/min (CFM)	13.7 (483.8)	13.7 (484)
Exhaust system backpressure (maximum allowable), kPa (in. water)	15.0 (60.2)	
Heat Rejection		
Heat rejection to exhaust (total), kW (BTU/min)	66.9 (3805)	
Heat rejection to atmosphere from engine, kW (BTU/min)	14.9 (847.3)	
Emissions (Nominal)²		
NOx + HC, g/kW-hr	4.42	
CO, g/kW-hr	1.02	
PM, g/kW-hr	0.26	

Alternator³

Voltages, V	480	208	600	240
Motor starting capability @ 30% Voltage Dip, skVA	72	64	128	85
Current, Amps	60	139	48	167
Frame size	M1736L4	M1754L4	M1736L4	M1754L4
Excitation	SE	SE	AREP	SE
Temperature rise, °C	130	130	130	130

Weights & Dimensions

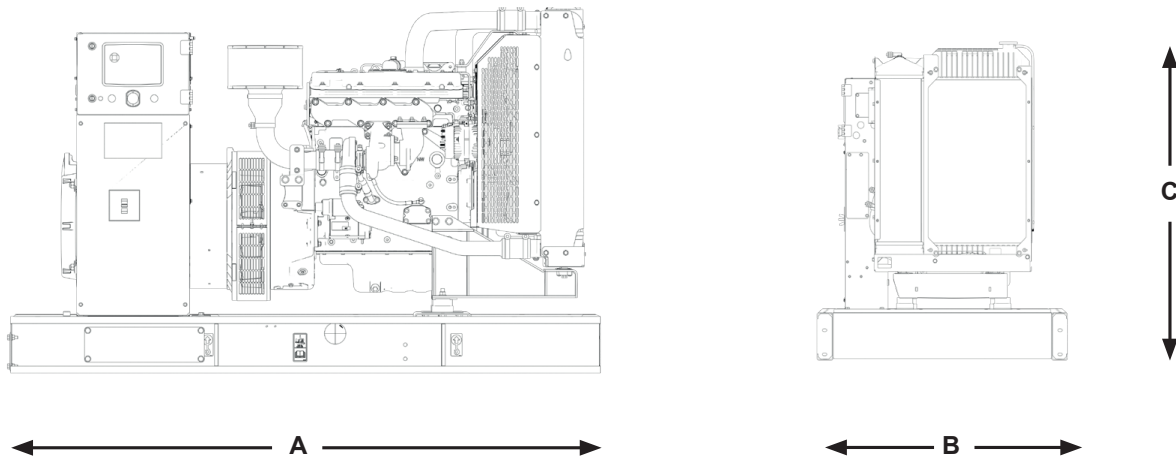

Length "A" mm (in)	Width "B" mm (in)	Height "C" mm (in)	Dry Weight kg (lb)
1962 (77.2)	1100 (43.3)	1220 (48.0)	838 (1847)

Note: General configuration not to be used for installation. See general dimension drawings for detail.

Applicable Codes and Standards

AS1359, CSA C22.2 No100-04, UL142, UL489, UL869, UL2200, NFPA 37, NFPA 70, NFPA 99, NFPA 110, IBC, IEC60034-1, ISO3046, ISO8528, NEMA MG1-22, NEMA MG1-33, 2006/95/EC, 2006/42/EC, 2004/108/EC.

Codes may not be available in all model configurations. Please consult your local Olympian representative for availability.

STANDBY: Output available with varying load for the duration of the interruption of the normal source power. Average power output is 70% of the standby power rating. Typical operation is 200 hours per year, with maximum expected usage of 500 hours per year.

RATINGS: Ratings are based on SAE J1349 standard conditions. These ratings also apply at ISO3046 standard conditions.

Definitions and Conditions

- ¹ For ambient and altitude capabilities consult your Olympian representative. Air flow restriction (system) is added to existing restriction from factory.
- ² Emissions data measurement procedures are consistent with those described in EPA CFR 40 Part 89, Subpart D & E and ISO8178-1 for measuring HC, CO, PM, NOx. Data shown is based on steady state operating conditions of 77° F, 28.42 in HG and number 2 diesel fuel with 35° API and LHV of 18,390 BTU/lb. The nominal emissions data shown is subject to instrumentation, measurement, facility and engine to engine variations. Emissions data is based on 100% load and thus cannot be used to compare to EPA regulations which use values based on a weighted cycle.
- ³ UL 2200 Listed packages may have oversized generators with a different temperature rise and motor starting characteristics. Generator temperature rise is based on a 40° C ambient per NEMA MG1-32.